

Ross Valley Fire Dept


San Anselmo, CA

This report was generated on 4/7/2021 3:56:29 PM



Breakdown by Major Incident Types for Date Range

Zone(s): All Zones | Start Date: 02/01/2021 | End Date: 03/31/2021

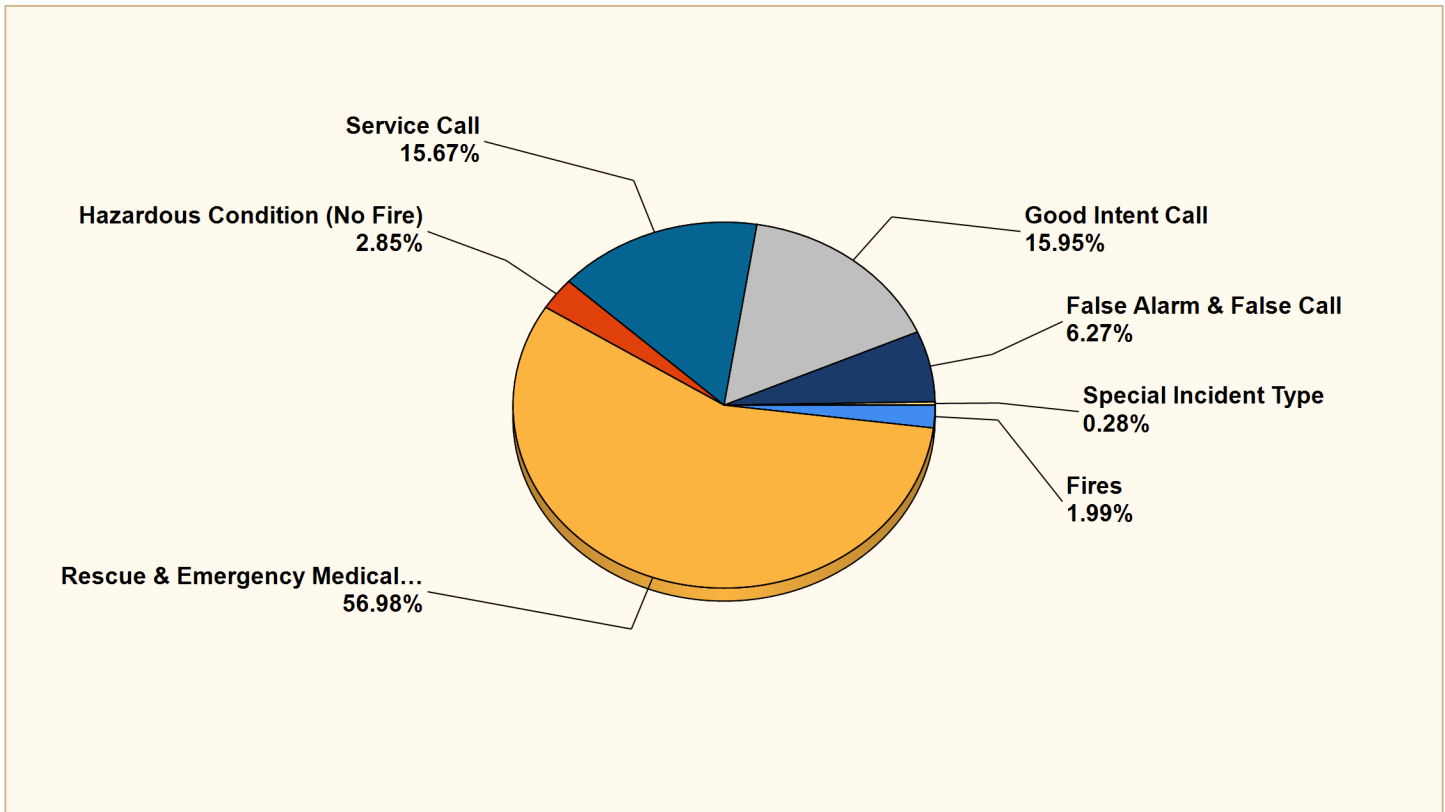

MAJOR INCIDENT TYPE	# INCIDENTS	% of TOTAL
Fires	7	1.99%
Rescue & Emergency Medical Service	200	56.98%
Hazardous Condition (No Fire)	10	2.85%
Service Call	55	15.67%
Good Intent Call	56	15.95%
False Alarm & False Call	22	6.27%
Special Incident Type	1	0.28%
TOTAL	351	100%

Only REVIEWED and/or LOCKED IMPORTED incidents are included. Summary results for a major incident type are not displayed if the count is zero.



emergencyreporting.com

Doc Id: 553

Page # 1 of 2

Item 5b

Page 1 of 4

Detailed Breakdown by Incident Type

INCIDENT TYPE	# INCIDENTS	% of TOTAL
111 - Building fire	3	0.85%
113 - Cooking fire, confined to container	3	0.85%
114 - Chimney or flue fire, confined to chimney or flue	1	0.28%
321 - EMS call, excluding vehicle accident with injury	193	54.99%
322 - Motor vehicle accident with injuries	6	1.71%
323 - Motor vehicle/pedestrian accident (MV Ped)	1	0.28%
412 - Gas leak (natural gas or LPG)	5	1.42%
440 - Electrical wiring/equipment problem, other	1	0.28%
444 - Power line down	3	0.85%
445 - Arcing, shorted electrical equipment	1	0.28%
500 - Service Call, other	2	0.57%
550 - Public service assistance, other	5	1.42%
551 - Assist police or other governmental agency	2	0.57%
552 - Police matter	2	0.57%
553 - Public service	16	4.56%
554 - Assist invalid	24	6.84%
571 - Cover assignment, standby, moveup	4	1.14%
600 - Good intent call, other	3	0.85%
611 - Dispatched & cancelled en route	38	10.83%
622 - No incident found on arrival at dispatch address	3	0.85%
650 - Steam, other gas mistaken for smoke, other	1	0.28%
651 - Smoke scare, odor of smoke	10	2.85%
671 - HazMat release investigation w/no HazMat	1	0.28%
700 - False alarm or false call, other	1	0.28%
733 - Smoke detector activation due to malfunction	1	0.28%
734 - Heat detector activation due to malfunction	3	0.85%
735 - Alarm system sounded due to malfunction	2	0.57%
736 - CO detector activation due to malfunction	1	0.28%
743 - Smoke detector activation, no fire - unintentional	6	1.71%
744 - Detector activation, no fire - unintentional	1	0.28%
745 - Alarm system activation, no fire - unintentional	7	1.99%
900 - Special type of incident, other	1	0.28%
TOTAL INCIDENTS:	351	100%

Only REVIEWED and/or LOCKED IMPORTED incidents are included. Summary results for a major incident type are not displayed if the count is zero.



ncyreporting.com

553

2 of 2

INCIDENT TYPE	# INCIDENTS
Station: 21 - STATION 21	Fairfax
321 - EMS call, excluding vehicle accident with injury	40
500 - Service Call, other	1
550 - Public service assistance, other	3
552 - Police matter	1
553 - Public service	6
554 - Assist invalid	3
611 - Dispatched & cancelled en route	6
650 - Steam, other gas mistaken for smoke, other	1
651 - Smoke scare, odor of smoke	2
734 - Heat detector activation due to malfunction	1
735 - Alarm system sounded due to malfunction	1
743 - Smoke detector activation, no fire - unintentional	2
744 - Detector activation, no fire - unintentional	1
# Incidents for 21 - Station 21:	68

Only REVIEWED incidents included.

